

UE-OI

IMPORTANT INSTALLATION INFORMATION

INSTALLATION INSTRUCTIONS


The HC-2 data enclosure should only be fitted at a height (approx 1.5 metres) where the engineer can install the electronic circuit board and can connect the cables to the terminals without the requirement of using step ladders or kneeling down.

Please Ensure cable wired for the communication circuits are as follow.

Cable For the Modbus circuits should be: **BELDEN 9841 LSZH LOW SMOKE ZERO HALOGEN**

Cable for the MBUS: **BELCOM 4101 P 1824**

Cable for HC2 Horizon Master Network: **BELCOM 5000182434 (Unit to Unit)**

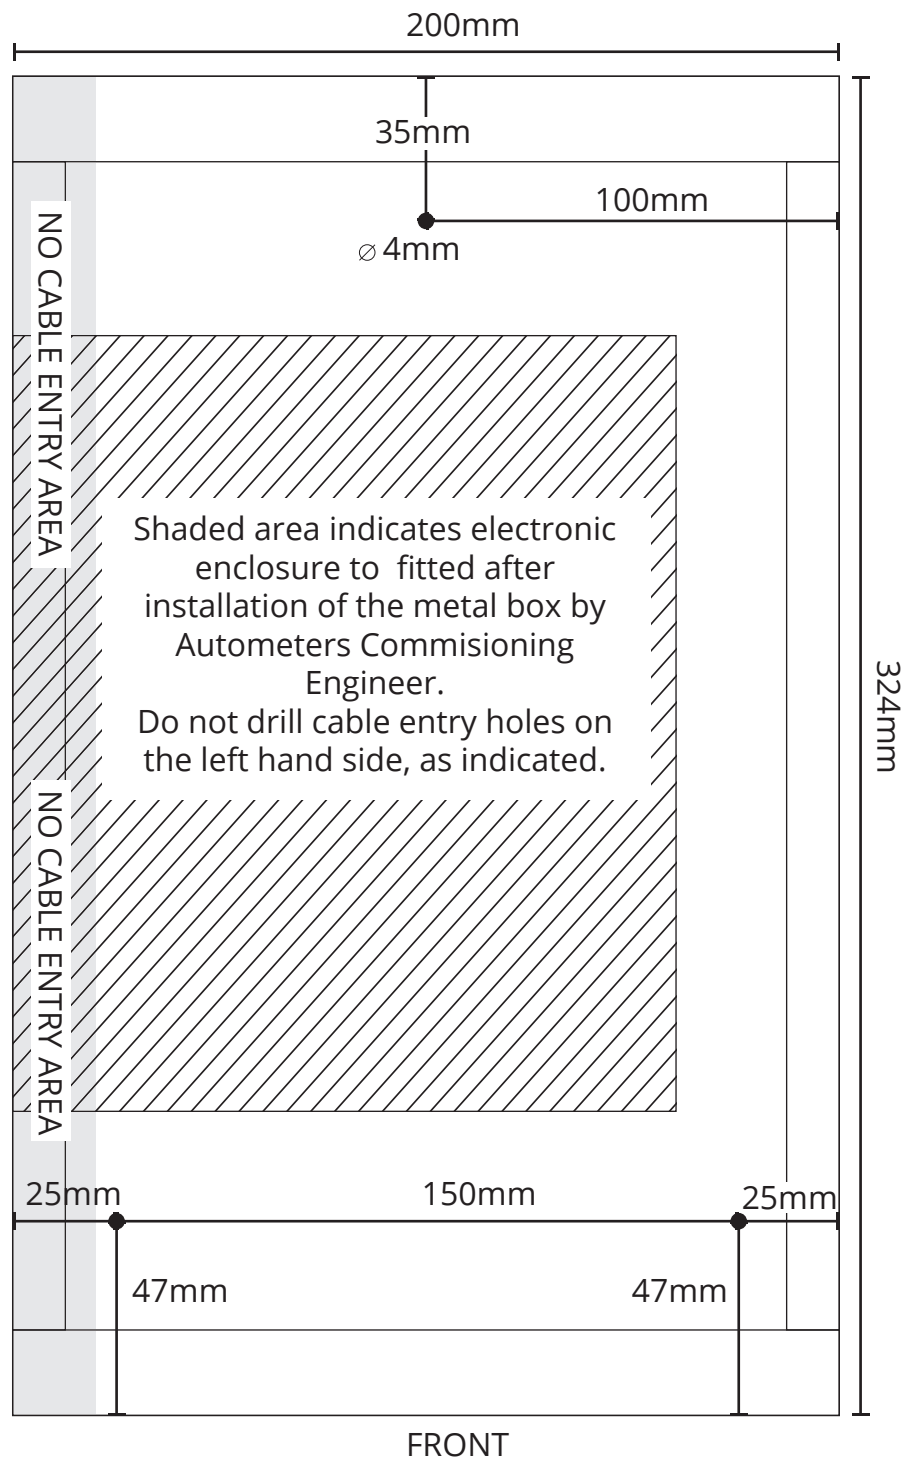

AUTOMETERS
SYSTEMS

Autometers Systems Ltd.

4B Albany Road, Chorlton-cum-Hardy, Manchester M21 0AW

Email: sales@autometers.co.uk

Phone: +44 (0)161 861 9056

Web: www.autometers.co.uk