

# ADP3-5C

## Energy Meters Three-Phase

### Application

The new ADP range of Multifunction digital power-meters with a green backlight LCD display, made for a fast and correct reading, are ideal instruments for installation in distribution panels, where the user can easily read and monitor more electrical parameters.

They are also used to measure the energy of three phase systems, for example in residential, generic and industrial applications. They are provided with two SO outputs: one for active imported energy, the other for active exported energy. The meters can be set up to transmit the electrical parameters by RS 485 Modbus (Autometers V6 protocol) by using the ADM-F external Modbus module. By transmitting the information to Autometers HORIZON metering system it is possible to analyze the energy-consumption and reduce the running costs to a minimum for industrial plants and buildings like Offices, Hospitals, Universities etc.



### Overview

The ADP3-5C is a 3 phase 4 wire 230/400 volt 5 Amp current transformer operated multifunction meter, four modules wide with a large and easy to read display showing many parameters of electrical energy, with its wide range of communications options makes it the ideal meter for most applications in distribution panels.

### Function


#### Display

|                         | Unit           | ID   |
|-------------------------|----------------|--|
| Current I               | A              | I1, I2, I3                                     |
| Tensions related        | V              | L1-N, L2-N, L3-N                               |
| Tensions between phases | V              | L1-L2, L2-L3, L3-L1                            |
| Power factor            | PF             | L1, L2, L3                                     |
| Frequency               | Hz             | L1   |
| Active power            | (kW)           | Utilization and instantaneous value  1,  2,  3 |
| Reactive power          | (kvar)         | Utilization and instantaneous value  1,  2,  3 |
| Apparent power          | (kVA)          | Utilization and instantaneous value L1, L2, L3 |
| Active energy           | Tariff         | (MWh) Wh Energy absorbed or supplied L         |
| Connection errors       |                | PLEASE Err                                     |
| Primary transformer     | 5 ... 10,000/5 | A CT (current transformer)                     |



Picture showing the installation of the external ADM-F Modbus module

### 4 Standard Module Housing 230/400 Volt 5 Amp (Current transformer operated)

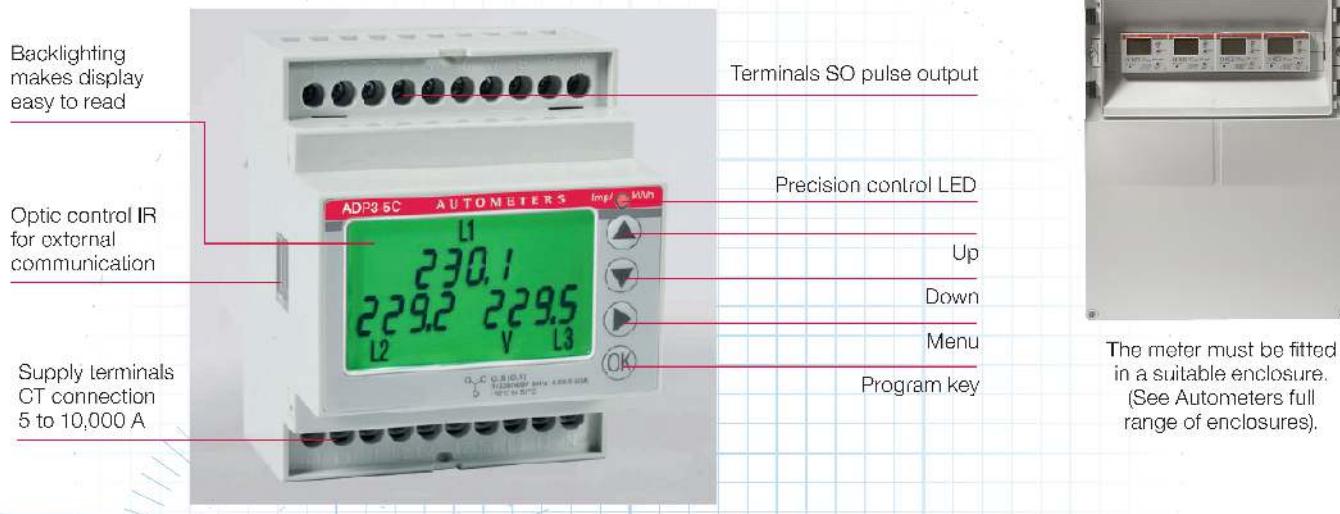

The meter must be fitted in a suitable enclosure.  
(See Autometers full range of enclosures).

**Technical Data**

Data in compliance with EN50470-1, EN50470-3, EN62053-23 and EN62053-31

| ADP3-5C  |  |  |  |
|--|--|--|--|
| <b>General characteristics</b>   |  |  |  |
| • Housing  | DIN 43880  | DIN  | 4 modules  |
| • Mounting   | EN 60715   | 35 mm<br>mm                                    | DIN rail   |
| • Depth  |  | -  | 70   |
| • Reference standard   | active energy<br>reactive energy - pulse output  |  | EN 50470-1-3<br>EN 62053-23-31   |
| <b>Operating features</b>  |  |  |  |
| • Connectivity   | to single/three-phase network  | n° wires                                       | 4  |
| • Storage of energy values and configuration                           | internal flash memory  | -  | yes  |
| • Tarif Supply   | for active energy  | -  | 1 Tarif  |
| • Rated control supply voltage <i>Un</i>                               | VAC  | 230  |  |
| • Operating range voltage  | V  | 184 ... 276                                    |  |
| • Rated frequency <i>fN</i>  | Hz   | 50 ±2%   |  |
| • Rated power dissipation (max. for phase) <i>Pv</i>                   | VA (W)   | ≤6 (0.6)                                       |  |
| <b>Overload capability</b>   |  |  |  |
| • Voltage <i>Un</i>  | continuous; phase/phase<br>1 second; phase/phase   | V  | 480  |
|  | continuous; phase/N<br>1 second; phase/N   | V  | 800  |
|  | continuous   | V  | 276  |
| • Current <i>Imax</i>  | momentary (0.5 s)<br>momentary (10 ms)   | A  | 300  |
|  |  | A  | 6  |
|  |  | A  | 120  |
| <b>Display (readouts)</b>  |  |  |  |
| • Connection errors and phase out                                      | discernible from phase-sequence indic.   | -  | PHASE Err  |
| • Display type   | LCD - Energy<br>LCD - Instantaneous<br>digit dimensions<br>tariff 1<br>overflows                                 | n° digits<br>n° digits<br>mm x mm<br>Wh<br>MWh | 9 (1 ... 3 decimal)<br>4 (1 ... 3 decimal)<br>6.00 x 3<br>0.01<br>8999999.99 |
| • Active energy: 1 display, 9 digit<br>+ display import/export (arrow) | W, kW or MW  | 000 ... 999.9                                  |  |
| • Instantaneous active power: 3 display, 3-digit                       | var, kvar or Mvar  | 000 ... 999.9                                  |  |
| • Instantaneous reactive power: 3 display, 3-digit                     | VA, kVA or MVA   | 000 ... 999.9                                  |  |
| • Instantaneous apparent power: 3 display, 3-digit                     | 1 display, 1-digit   | T1   |  |
| • Instantaneous tariff measurement                                     | A  | 5 ... 10.000                                   |  |
| • Transformer primary current  | s  | 1  |  |
| • Display period refresh   |  |  |  |
| <b>Measuring accuracy</b>  |  |  |  |
| • Active energy and power  | acc.to EN 50470-3  | class 1  | B  |
| • Reactive and apparent power  | acc.to EN 62053-23   | class 2  | 2  |
| <b>Measuring input</b>   |  |  |  |
| • Type of connection   |  |  | Transformer ... /s A   |
| • Voltage <i>Un</i>  | phase/phase<br>phase/N<br>phase/phase<br>phase/N   | V<br>V<br>V<br>V                               | 400<br>230<br>319 ... 480<br>184 ... 276                                     |
| • Operating range voltage  |  |  |  |
| • Current <i>Iref</i>  | A  | -  |  |
| • Current <i>In</i>  | A  | 5  |  |
| • Current <i>Imin</i>  | A  | 0.05   |  |
| • Operating range current: ( <i>ist</i> ... <i>imax</i> )              | direct connection<br>Transformer connection  | A<br>A   | -<br>0.003 ... 0   |
| • Transformer current  | primary current of the transformer<br>smallest input step adjust. in 5 A steps                                   | A<br>A   | 5 ... 10.000<br>5  |
| <b>Measuring input</b>   |  |  |  |
| • Frequency  | Hz   | -  | 50   |
| • Input waveform   |  |  | sinusoidal   |
| • Starting current for energy measurement ( <i>ist</i> )               | mA   | -  | 3  |
| <b>Pulse output SO</b>   |  |  |  |
| • 2 pulse output   | 1 pulse output for energy export<br>1 pulse output for energy import<br>depending on the transf. factor, adjust. | -  | yes<br>yes<br>adjustable (depends on CT);<br>30 ±2 ms                        |
| • Quantity pulse output  | Imp/kWh  |  |  |
| • Pulse duration   | rms  |  |  |
| • Required voltage   | VAC (DC)   |  | 5 ... 230 ±5% (5 ... 300)  |
| • Permissible current  | mA   |  | 90   |
| • Permissible current  | µA   |  | 1  |
| <b>Safety acc. to EN 50470-1</b>                                       |  |  |  |
| • Indoor meter   | -  | -  | yes  |
| • Degree of pollution  | V  | -  | 2  |
| • Operational voltage  | kV   | 300  |  |
| • AC voltage test (EN 50470-3, 7.2)                                    |  | 4  |  |
| • Impulse voltage test   | 1.2/50 µs kV   | 6  |  |
| • Protection class (EN 50470)  | class  | II   |  |
| • Housing material flame resistance                                    | class  | VO   |  |

continued on next page

## Technical Data

Data in compliance with EN50470-1, EN50470-3, EN62053-23 and EN62053-31



### Adaptor for Communication (only for ADP3-5C)

|  |  |                 |                  |
|--|--|-----------------|------------------|
| • Modbus RTU, ASCII interface  | RS-485 – 3 wires   | -               | up to 19.200 bps |
| <b>Connection terminals</b>  |  |                 |                  |
| • Type cage main current paths                                       | scREW head 7 +/ -  | P07DRIV         | P71              |
| • Type cage pulse output   | blade or slot screw  | mm              | 0.8 x 3.5        |
| • Terminal capacity main current paths                               | solid wire min. (max.)   | mm <sup>2</sup> | 1.5 (8)          |
| • Terminal capacity pulse outlet                                     | stranded wire with sleeve min. (max.)                                    | mm <sup>2</sup> | 1.5 (8)          |
| • Environmental conditions   | solid wire min. (max.)   | mm <sup>2</sup> | 0.14 (2.5)       |
| • Mechanical environment   | stranded wire with sleeve min. (max.)                                    | mm <sup>2</sup> | 0.14 (1.5)       |
| • Electromagnetic environment  | -  | -               | M1               |
| • Operating temperature  | -  | -               | E2               |
| • Limit temperature of transportation and storage                    | °C   | 10 ... +55      |                  |
| • Relative humidity (not condensation)                               | °C   | -25 ... +70     |                  |
| • Vibrations   | %  | 80              |                  |
| • Degree protection  | 50 Hz sinusoidal vibration amplitude housing when mounted in front (e-m) | mm              | -0.05            |
| (*) For the installation in a cabinet at least with IP51 protection. |  |                 |                  |
| IP51(*)/P20  |  |                 |                  |

(\*) For the installation in a cabinet at least with IP51 protection.

## Circuit Diagrams


### 3 Phase 4 wire Connection Diagram

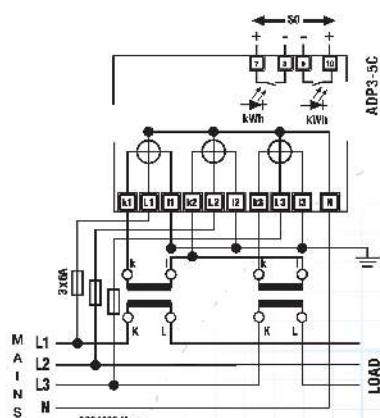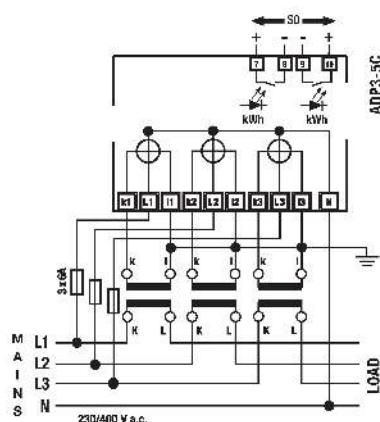

Wire N needs to be connected to the Power-meter

## Dimensions

ADP3-5C

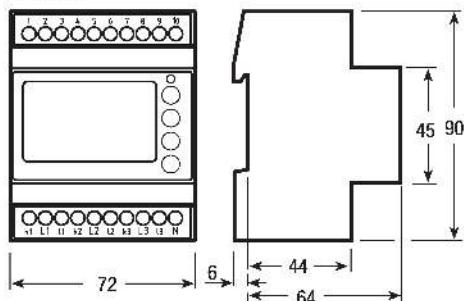

### Instructions for the connection of transformer counters

A fuse of 6 A is recommended for the line protection. Current transformers must not be operated with open terminals since dangerous high voltages might occur which may result in personal injuries and property damage. In addition to this, the transformers are exposed to thermal overload.

### Table indicating Current Transformer Ratio for Impulses per kWh

#### 50 Pulses for kWh (always limited to 16.6 Hz)



For xx/5A, the available range depends on external CT, as follows:

| CT Ratio       | Imp/kWh |
|----------------|---------|
| 5              | 10000   |
| 10             | 5000    |
| 15 ... 30      | 2000    |
| 35 ... 60      | 1000    |
| 65 ... 120     | 500     |
| 125 ... 300    | 200     |
| 305 ... 600    | 100     |
| 605 ... 1200   | 50      |
| 1205 ... 3000  | 20      |
| 3005 ... 6000  | 10      |
| 6005 ... 10000 | 5       |

*Display Registers*

**Main Menu**

**Measurements - Start Up**

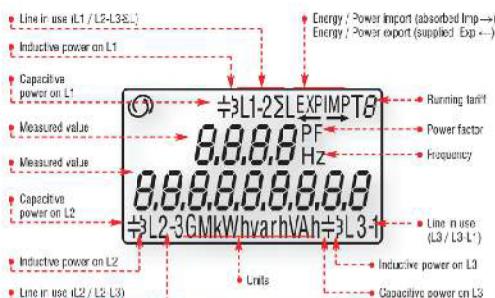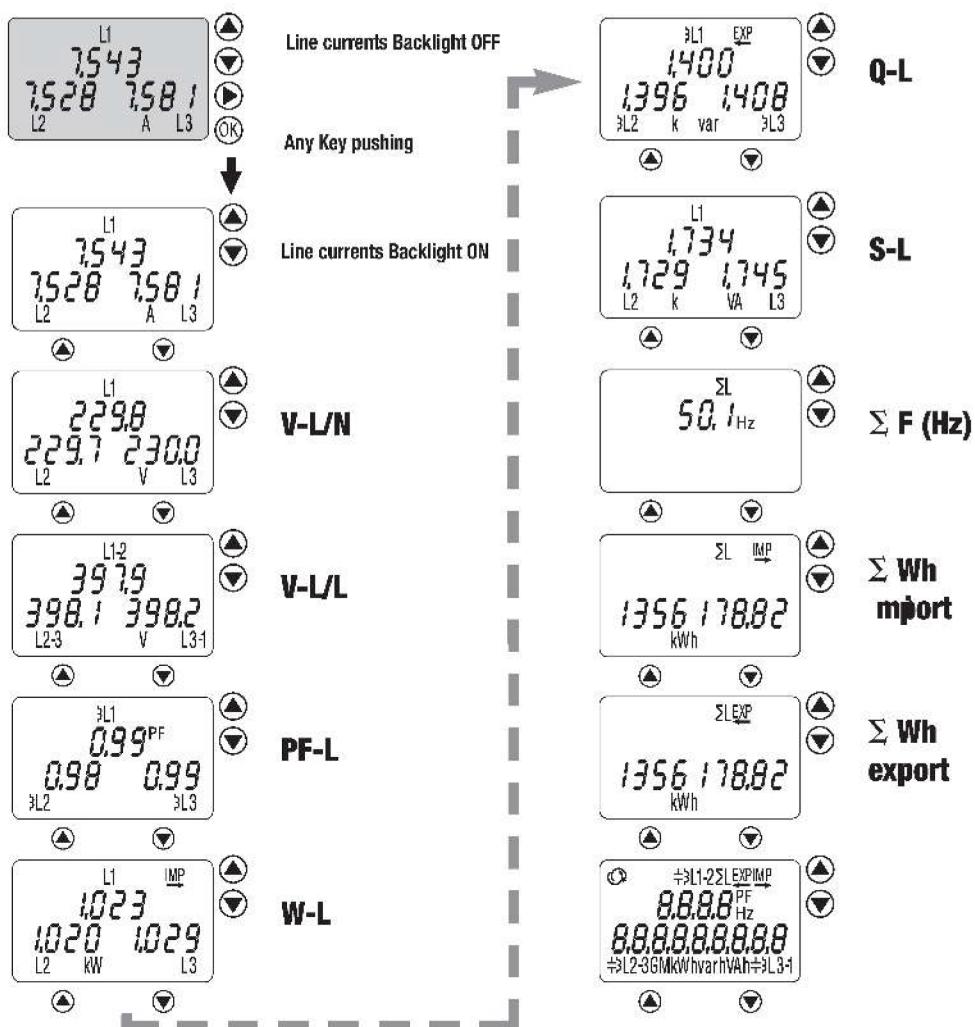

**Autometers Systems Limited**

4B Albany Road, Chorlton-cum-Hardy, Manchester, M21 0AW

Tel: +44 (0) 161 861 9056 Fax: +44 (0) 161 881 3745

[www.autometers.co.uk](http://www.autometers.co.uk) Email: [sales@autometers.co.uk](mailto:sales@autometers.co.uk)

Product development is continuous and Autometers Systems Ltd reserves the right to make alterations and manufacture without notice. Products as delivered may therefore differ from the descriptions and illustrations in this publication.